


Asphalt Shingle Roofing



**BUILDING
INSPECTIONS**
City of Richfield

The Minnesota State Building Code and Richfield City Code provide minimum standards for creating an environment of health and safety for all Richfield residents.

PURPOSE: To provide general reference for a residential reroofing project of homeowners and contractors using asphalt shingles. Always refer to the manufacturer's application instructions.

SCOPE: Applies to all buildings where portions or all of the roof covering is to be replaced.

INSPECTIONS: There are two inspections required; a tear-off inspection when the roof is cleared of old roof covering to ensure roof substrate or roof boards, sidewall step flashing, kick-out flashing, chimney saddles and other flashings have no deterioration, adequate attic ventilation is added, ice and water protection at the eaves are installed and a final inspection. A new layer of ice and water can not be applied over existing products with shingle debris attached to it. It must be clean and all lap joints staggered. All roofing contractors are required to be licensed by the Minnesota Department of Labor and Industry.

Before undertaking any re-roofing project there are several questions that should be considered to ensure a successful project and make it go smoothly. You should familiarize yourself with all aspects of the reroofing process before you begin. The fact is, there are various conditions about your roof that may limit your product choices or affect the cost of your roofing job. The 2007 Minnesota State Building Code adopts the 2006 International Residential Code (2006 IRC). All "R" code references provided in this brochure pertain to the 2006 IRC.

Do I need a new roof?

How old is it? A roof that has been properly installed with ventilation and has not been damaged can last 20 years or more. An inspection of the roof should be done periodically. Look for cracks, curled or cupped shingles, worn mineral coatings, exposed nails, previous patches, holes and exposed underlayment or sheathing.

Does the roof leak? If the answer is yes, it is necessary to determine why. If you have inspected the roof and it looks sound, your problem could be roof flashing. Many roof leaks are the result of bad or misapplied flashing. You should spend time in the attic looking for water stains, particularly around vents, chimneys and vertical wall elements above the roof. A garden hose can help you find the leak. Flashing can sometimes be replaced or repaired without installing a whole new roof.

Do it myself or hire a professional? This is a question only you can answer based on your skill level and time. An asphalt roofing project can be successfully accomplished by the homeowner if you take the time to become familiar with the roofing procedures. Be sure to plan your project around the weather and allow enough time to get a proper cover on the roof before it rains. Steep-sloped asphalt roofs and those with multiple valleys can present special challenges, so be sure you have the right equipment and skills before undertaking this type of roofing project. Other types of roofs such as wood shingles, shakes and clay tile are not normally taken on by the "do-it-yourself" homeowner because of the special skills required. Remember, if you decide to hire a professional, be sure the company is a state-licensed contractor or roofer.

This handout is written as a guide to common questions and problems.

It is not intended nor shall it be considered a complete set of requirements.

City of Richfield ● 6700 Portland Avenue South ● Inspections Division ● (612) 861-9860
Zoning Administrator ● (612) 861-9760
Fire Chief ● (612) 243-4502

To confirm if your contractor is licensed in Minnesota contact the:

Department of Labor and Industry
Residential Building Contractors
Phone: (651) 284-5069 or 1-800-657-3944
www.doli.state.mn.us/contractor.html
E-mail: DLI.Contractor@state.mn.us

Should I overlay the existing roof or tear off the existing shingles? New roof coverings shall not be installed without first removing existing roof coverings in Hennepin County. Removal of asphalt shingles is required in areas designated as having moderate or severe hail exposure.

What is roof slope and does it limit the choice of shingles? Asphalt shingles shall only be used on roof slopes of two units vertical in 12 units horizontal (2:12) or greater. Must follow manufacturer's specifications. The slope of the roof is measured by the vertical rise of the roof to the horizontal run and is expressed as a fraction. A "4/12 roof slope" means the roof rises 4 feet for every 12 feet of horizontal roof span.

Roof slopes between 2/12 and 4/12 can use shingles. Roof application techniques shall follow manufacturer's installation requirements for low sloped roofs which will address a greater potential for ice dam/water backup. They may require two layers of underlayment or a continuous layer of self-adhering polymer modified bitumen sheet.

Always refer to the manufacturer's application instructions.

Roof ventilation is required. Enclosed attics and enclosed rafter spaces formed where ceilings are applied directly to the underside of the roof rafters shall have cross ventilation for each separate space by ventilating openings protected against the entrance of rain or snow. Ventilating openings shall be provided with corrosion-resistant wire mesh, with 1/8 inch (3.2 mm) minimum to 1/4 inch (6.35mm) maximum openings.

Minimum area: The total net-free ventilating area shall not be less than 1:150 of the area of the space ventilated exempt that the total area is permitted to be reduced to 1:300, provided at least 50 percent and not more than 80 percent of the required ventilating area is provided by ventilators located in the upper portion of the space to be ventilated at least 3 feet (914mm) above eave or cornice vents with the balance of the required ventilation provided by eave or cornice vents. As an alternative, the net free cross-ventilation area may be reduced to 1:300 when a vapor barrier having a transmission rate not exceeding one per (57.4 mg/s-m²-Pa) is installed on the warm side of the ceiling. It might be necessary to add ventilation with your new roof to meet these standards.

How can you determine if the roof is properly ventilated? An attic needs to breathe. An effective ventilation system will help prevent attic heat build-up, attic moisture and condensation, ice dam build-up and weather infiltration such as drifting, snow and wind driven rain.

Research has shown that proper ventilation is necessary if the shingles are to last their design life.

Code requirements for asphalt shingles.

A typical installation of asphalt shingles is illustrated below for use on roofs 4/12 and greater. However, the code also permits application on a roof that has a slope of less than 4/12 if the low-slope-roofing procedures are used per manufacturer requirements.


Fasteners for asphalt shingles shall be galvanized steel, stainless steel, and aluminum or copper roofing nails, minimum 12 gage (0.105 inch (2.67 mm)) shank with a minimum 3/8 inch (9.5 mm.) diameter head, ASTM F 1667, of a length to penetrate through the roofing materials and a minimum of 3/4 inch (19.1 mm) into the roof

This handout is written as a guide to common questions and problems.

It is not intended nor shall it be considered a complete set of requirements.

City of Richfield ● 6700 Portland Avenue South ● Inspections Division ● (612) 861-9860
Zoning Administrator ● (612) 861-9760
Fire Chief ● (612) 243-4502

sheathing. Where the roof sheathing is less than 3/4 inch (19.1 mm) thick, the fasteners shall penetrate through the sheathing. Fasteners must comply with ASTM F 1667. Staples are not permitted for shingle application unless specifically noted in the manufacturer's installation instructions on the shingle package.

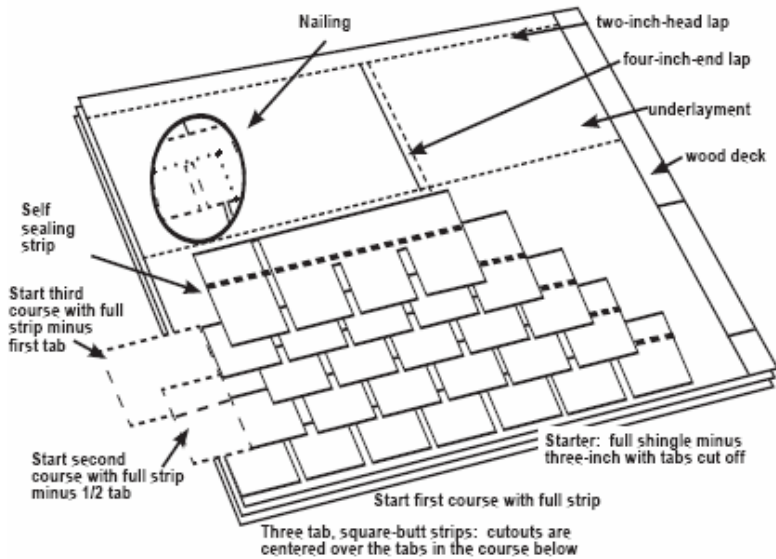

The code requires that underlayment of one layer of non-perforated Type 15 felt lapped two inches horizontally and four inches vertically to shed water. In addition, an ice barrier that consists of at least two layers of underlayment cemented together or of a self-adhering polymer modified bitumen sheet, shall be used in lieu of normal underlayment and extend from the eave's edge to a point at least 24 inches (610 mm) inside the exterior wall line of the building.

Valley linings shall be installed in accordance with manufacturer's installation instructions before applying shingles. Valley linings of the following types shall be permitted.

1. For open valley (valley lining exposed) lined with metal, the valley lining shall be at least 24 inches wide and of any of the corrosion-resistant metals in Table R905.2.8.2.
2. For open valleys, valley lining of two plies of mineral surface roll roofing complying with ASTM D3909 or ASTM D6380 Class M shall be permitted. The bottom layer shall be 18 inches (457 mm) and the top layer a minimum of 36 inches (914mm) wide.
3. For closed valleys (valley covered with shingles), use a valley lining of one ply of smooth-roll roofing complying with ASTM D6380 Class S Type III, Class M Type II or ASTM D3909 and at least 36 inches wide or a valley lining (as described in items 1 and 2 above) shall be permitted. Specialty underlayment complying with ASTM D 1970 may be used in lieu of the lining material.

A cricket or saddle shall be installed on the ridge side of any chimney greater than 30 inches (762 mm) wide and sloped in a way to direct water past the corners of the chimney. Cricket or saddle coverings shall be sheet metal or the same material and slope as the existing roof and covering. Chimney crickets shall comply with R1003.20.

Kick-out flashing shall be installed where the lowest portion of a sloped roof stops within the plane of an intersecting wall cladding, in such a manner as to divert or kick out water away from the assembly.

This handout is written as a guide to common questions and problems.

It is not intended nor shall it be considered a complete set of requirements.

City of Richfield • 6700 Portland Avenue South • Inspections Division • (612) 861-9860

Zoning Administrator • (612) 861-9760

Fire Chief • (612) 243-4502

Sidewall flashing against a vertical-sidewall shall be by the step-flashing method providing flashing over each course layer of shingles in a weaving pattern as to direct water flow out over the top of the lower course layer of shingles to day light in shingle fashion.

Other flashing, such as flashing against a vertical-front wall and the soil stack, vent pipe and chimney flashing shall be applied according to asphalt shingle manufacturer's printed instructions.

This handout is written as a guide to common questions and problems.

It is not intended nor shall it be considered a complete set of requirements.

City of Richfield ● 6700 Portland Avenue South ● Inspections Division ● (612) 861-9860
Zoning Administrator ● (612) 861-9760
Fire Chief ● (612) 243-4502

